

NPEXA-C7  
Isolated Safety Barrier

→ **Introductions**

This isolated safety barrier converts the RS485 digital signals from a hazardous area into RS485 digital signals to a safe area by isolation, and also provides transmitters with power in the hazardous area.

The input, output, and power supply are galvanically isolated from each other.

→ **Parameters**

**Explosive-proof grade:** [Ex ia Ga] IIC

**Power supply:**

Connection type: Terminals ( 4+, 5-)

Rated voltage: 8 V DC ~ 60 V DC

**Input (1, 2):**

Input signal: RS485 digital signal

Control mode: half-duplex

**Distribution (3, 6):**

Distribution setting: Refer to rotary switch setting

Voltage tolerance: ± 0%

**Output (7, 8):** RS485 digital signal

**Transmission characteristics:**

Transmission delay: ≤ 5 μs

Transmission rate: ≤ 56 kbps

**Electromagnetic compatibility:** Accordance to IEC 6 326-3-

**Dielectric strength (1 mA leakage current, 1 minute test time):**

≥ 3000 V AC (intrinsically safe side / non-intrinsically safe side)

≥ 500 V AC (non-intrinsically safe side / non-intrinsically safe side)

**Insulation resistance:** ≥ 00 MΩ (Input /Output/Power supply)

**Parameters certified by China National Quality Supervision and Test Centre for Explosion Protected Electrical Products (CQST):**

U<sub>m</sub>: 250 V

Terminals 1, 2:

U<sub>o</sub>: 7.6 V I<sub>o</sub>: 77 mA P<sub>o</sub>: 47 mW C<sub>o</sub>: 7 μF L<sub>o</sub>: 6 mH

Terminals 3, 6:

U<sub>o</sub>: 23. V I<sub>o</sub>: 87 mA P<sub>o</sub>: 080 mW C<sub>o</sub>: 0. μF

L<sub>o</sub>: 0.34 mH

**Ambient conditions:**

Operation temperature: -20 °C ~ +60 °C

Relative humidity: 0% RH ~ 90% RH (40 °C)

Atmosphere pressure: 80 kPa ~ 06 kPa

Storage temperature: -40 °C ~ +80 °C

**Power dissipation:**

≤ 2 W (Distribution: 8 V/9 V/ 2 V, 50 mA)

≤ 3.5 W (Distribution: 5 V/6 V, 00 mA)

→ **Wiring diagram**

a s t o

○ The transmission cable in the figure is recommended to use the parameters of pair

**Parameters:**

The this Parameter

**istics:**


Ideu

P

The th

Nanjing New Power Electric Co., Ltd.

the hazardous area.

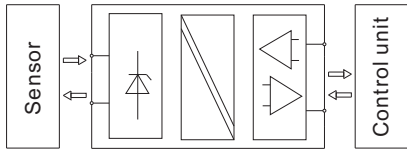

### → Installation

- The apparatus can be installed on the DIN 35 mm standard rail which is corresponding to DIN IEC 607 5. The must be snapped onto the rail, and never slanted or tipped to the side.
- Installation and disassembly steps are shown in following figures:

shown, pull downward the springs, and rotate the safety barrier.

- C. Remove the safety barrier as arrow shows.
- As far as possible to mount it vertically, In order to dissipation the heat of the apparatus.

### → Attention


- Isolated Safety Barriers degree of protection is IP 20 and must be protected from undesirable ambient conditions (waterproofing, small foreign objects). It is suitable for installation in the control room or high density field cabinet, DIN 35 mm installation is convenient for installation and displacement.
- The devices were designed for use in pollution degree 2 and overvoltage category III as per IEC/EN 60664- . If used in areas with higher pollution degree, the devices need to be protected accordingly.
- Installation position shall not be affected by strong mechanical vibration; impact and electromagnetic induction from signal terminal and power supply, should conformity with the requirements on electromagnetic interference resistance of products in Class 3 industrial field atmosphere stipulated in IEC 6 000-4; the atmosphere shall be free from gases that are corrosive to metal and plastic components.
- The apparatus must be installed, connected and adjusted by qualified personnel in non-hazardous area according with the instruction manual.
- The operator must strictly comply with the relevant local safety standards and guidelines.

### → Supplementary instructions

- Our company reserves the right to change the product information without prior notification to the user. If the contents of the description are different from website or sample, this description shall prevail.

- A. Snap metal lock onto mounting rail, then rotate the safety barrier, as figure A, press down the safety barrier onto mounting rail.

Vertically installation



- B. Pry the metal lock off the rail with screwdriver as arrow

### → Light indication

- **PWR**: Power indicator light shows green, it means work normally.
- **TX (yellow)**: The indicator flashes while data sending and turns on when sending data fails. Otherwise, the indicator turns off when normal.
- **RX (green)**: The indicator flashes while data receiving and turns on when receiving data fails. Otherwise,the indicator turns off when normal.